TEST REPORT

on behalf of Yueqing Sino Cable Gland Factory. Cable Glands

Prepared For: Yueqing Sino Cable Gland Factory. Changhong Industrial Zone, Liushi, Yueqing, Zhejiang

Prepared By: Shanghai Global Testing Services Co., Ltd. Floor 2nd, Building D-1, No. 128, Shenfu Road, Minhang District, Shanghai, China.

Report No.:TLZJ18103015897Date of Test:October 30, 2018 to November 08, 2018Date of Report:November 08, 2018



Page 1 of 12

TEST REPORT EN 62444

Metric Cable Glands for electrical Installations

	TLZJ18103015897
Report Reference No	TLZJ18103015897
Tested by (name+signature):	Sophia Yu
Approved by (name+signature):	Brain Vent
Approved by (name + signature)	Kent Hook
Date of issue	November 08, 2018
Testing Laboratory	Shanghai Global Testing Services Co., Ltd.
Address	Floor 2nd, Building D-1, No. 128, Shenfu Road, Minhang District,
	Shanghai, China.
Testing procedure	CE
Applicant's name	Yueqing Sino Cable Gland Factory.
Address	Changhong Industrial Zone, Liushi, Yueqing, Zhejiang.
Test specification:	
Standard	⊠ EN 62444:2013.
Test procedure	CE
Non-standard test method	N/A
Test Report Form No.	
TRF Originator	GTS
Master TRF	Dated 2010-05
Test item description:	Cable Glands
Model/Type reference:	See the next page
Ratings	/



Model/Type reference:	Plastic Cable Glands:
	(1) PG7, PG9, PG11, PG13.5, PG16, PG21, PG29, PG36, PG42, PG48
	(2) M10x1.5, M12x1.5, M14x1.5, M16x1.5, M18x1.5, M20x1.5, M22x1.5, M2
	4x1.5, M25x1.5, M27x1.5, M30x1.5, M32x1.5, M36x1.5, M40x1.5, M50x1.5, M63x
	1.5, M75x2
	(3) NPT1/4", NPT3/8", NPT1/2", NPT3/4", NPT1", NPT1-1/4", NPT1-1/2"
	(4) G1/4", G3/8", G1/2", G3/4", G1", G1-1/4", G1-1/2", G2"
	(5) BSC1/2", BSC5/8", BSC3/4", BSC7/8", BSC1", BSC1-1/4", BSC1-1/2", BSC2"
	(6) BSP1/4", BSP3/8", BSP1/2", BSP3/4", BSP1", BSP1-1/4", BSP1-1/2", BSP2",
	BSP2-1/2", BSP3", BSP4"
	Metal Cable Glands:
	(1) PG7, PG9, PG11, PG13.5, PG16, PG21, PG29, PG36, PG42, PG48
	(2) M6x1, M8x1.25, M10x1.5, M12x1.5, M14x1.5, M16x1.5, M18x1.5, M20x1.5, M
	22x1.5, M24x1.5, M25x1.5, M27x1.5, M28x1.5, M30x1.5, M32x1.5, M36x1.5, M37
	x1.5, M40x1.5, M42x1.5, M47x1.5, M48x1.5, M50x1.5, M54x1.5, M56x1.5, M60x1
	.5, M63x1.5, M64x1.5, M72x2, M75x2, M76x2, M80x2, M88x2, M90x2, M100x2,
	M110x2, M114x2, M120x2, M125x2, M150x2
	(3) NPT1/4", NPT3/8", NPT1/2", NPT3/4", NPT1", NPT1-1/4", NPT1-1/2", NPT2",
	NPT2-1/2", NPT3", NPT4"
	(4) G1/4", G3/8", G1/2", G3/4", G1", G1-1/4", G1-1/2", G2", G2-1/2", G3", G4", G4 -1/2"



Copy of marking plate:

1

Summary of testing:

This test report complies with EN62444

1. These cable glands are designed for use with unarmoured cable. These cables must be with extruded

sealing (solid polymeric) completely surrounding the "core" (insulation and conductor), allowing for no holes or ventilation through the inner jacket or along the cores.

2. These cable glands are designed for appropriate cable, as per the manufacturer's specifications, to maintain integrity of the installation.

3. According to manual, threads number is at least 5 fully engaged threads.

Test Report Content

This test report consists of:

Main report

Annex I: Photo Documentation, 4 page(s).



Test item particulars:					
Degree of protection against access to hazardous parts and against harmful ingress of solid foreign objects	IP6X				
Degree of protection against harmful ingress of water:	IPX8				
Material (6.1) of cable gland	⊠ Metallic ⊠ Non-Metallic □ Composite				
Mechanical properties (6.2):	Without cable anchorage/-With cable anchorage (type A/ type B)-/Cable retention for armoured cable (class- A/class B)/				
Electrical properties (6.3)	with electrical continuity characteristics/ with insulating- characteristics-				
Resistance to external influences (6.4)	IP20 IP code if not in 8.4/-20-80°C temperature range if not in 8.6/resistance to slat and sulphur dioxide laden- atmospheres.				
Test case verdicts:					
Test case does not apply to the test object:	N/A				
Test object does meet the requirement:	Pass (P)				
Test object does not meet the requirement:	Fail (F)				
Testing:					
Date of receipt of test item:	October 30, 2018				
Date(s) of performance of test	October 30, 2018 to November 08, 2018				
General remarks:					
The test results presented in this report relate only to the item(s) tested.					
This report shall not be reproduced, except in full, without the written approval of the testing laboratory.					
"(see remark #)" refers to a remark appended to the report.					
"(see Annex #)" refers to an annex appended to the report.					
"(see appended table)" refers to a table in the CB Test Report.					
Throughout this report a comma (point) is used	as the decimal separator.				



Page 5 of 12

Remarks:

1. The samples for each group of testing were selected randomly from the samples provided by the manufacturer.

2. The test results reported in this test report shall refer only to the sample actually tested and shall not refer or

be deemed to refer to bulk from which such a sample may be said to have been obtained.

3. The trademark and type identification are shown both in manual and enclosure. See manual firstly.

4. Determination of the test result includes consideration of measurement uncertainty from the test equipment and methods.

5. We conclude that the product(s) presented in this test report complies (comply) with the standard according to the test results on the submitted samples.

Component Data Form (CDF):

Material: Plastic/Metal



Page 6 of 12 TLZJ18103015897

EN 62444:2013.				
Clause	Requirement – Test	Result	Verdict	
7	MARKING AND DOCUMENTA		Р	
7.1	An appropriate part of the cable gland shall be legibly and durably marked in a visible place with the following:		Р	
	-name, logo or registered mark:		Р	
	-identification (or type reference)		Р	
7.2	Marking durable and easily legible. Test: 15 s with water and 15 s with petroleum spirit		Р	
	Compliance is checked by inspection		Р	
7.3	Shall provide in his literature, such as			
	 sealing range installation torques entry thread length type of cable anchorage and anchorage range impact category correct assembly of the cable gland IP code in accordance with EN60529 (not 8.4) temperature range (not 8.6) resistance to salt and sulphur dioxide laden atmospheres multi orifice seals 	See some information in page 4 and/or manual provided by supplier/manufacture		
8	CONSTRUCTION		Р	
8.1	Those parts of a cable gland that are used for tightening or for holding during installations should be hexagon form		N	
	Alternatives to the hexagon form, if any		N	
	The entry thread, if any, shall be constructed in accordance with table 1 of EN 60423	EN 60423	Р	



Page 7 of 12 TLZJ18103015897

	EN 62444:2013.				
Clause	Requirement – Test	Result	Verdict		
8.2	All external projection edges, and corners of cable gland components shall be smooth, to prevent danger from injury in handling the cable gland		P		
8.3	Cable glands shall be constructed to avoid cable damage when installed in accordance with manufacturers		Р		
8.4	Cable glands shall provide a minimum degree of IP54 Compliance is checked by 9.4 and 9.5	IP68	Р		
8.5	Care shall be taken in the construction of cable glands to ensure than no detrimental effects occur between dissimilar materials which may impair the performance of the cable glands				
8.6	Cable glands shall be suitable for use with in a minimum temperature range of –20°C to 65°C. For test purposes the temperature tolerance is +/-2°C	–20°C to 80°C	Р		
9 9.1	MECHANICAL PROPERTIES Cable retention for cable glands without protective bonding to earth.		P		
	Except for armoured cables, which are tested in accordance with 10.4.1, compliance is checked by the following test.		Р		
	Cable glands declared to have cable anchorage in accordance with 6.2.2 are tested in accordance with 9.3, if the sealing range and the anchorage range are the same.		Р		
	For test mandrels which are not circular in shape i.e. where non-circular cables are being simulated, their cross- sectional area shall be determined, and the diameter of a circular cable of the same cross-sectional area shall be calculated. The test		N		



Page 8 of 12 TLZJ18103015897

EN 62444:2013.				
Clause	Requirement – Test	Result	Verdict	
	values shall be appropriate to the nearest circular test			
	mandrel size.			
	The test mandrel is marked when unloaded so that		Р	
	any displacement relative to the cable gland can be			
	easily detected.			
	The load is maintained for 5 min and at the end of this	<=2mm	Р	
	period the displacement shall be not exceed 3 mm			
	when unload.			
9.2	Cable retention for cable glands with protective		N	
	bonding to earth			
	Cable glands declared in accordance with 6.3.1.3		N	
	shall provide cable retention.			
9.3	Cable anchorage		Р	
	Cable glands declared with cable anchorage in		Р	
	accordance with 6.2.2 shall relieve the conductors			
	from strain, including twisting			
	Compliance is checked by the following tests.		-	
	The test mandrel is marked when unloaded so that		Р	
	any displacement relative to the gland can be easily			
	detected.			
	The test mandrel is pulled for a duration of 1 s, 50		Р	
	times, without jerks in the direction of the axis with the			
	relevant force specified in Table 2A.			
	At the end of this period the displacement shall not	<2mm	Р	
	exceed 2 mm. This measurement is to be carried out			
	after unloading the force the test mandrel.			
	The sample with the test mandrel is then mounted		Р	
	onto the test arrangement for the cable anchorage			
	twist test.			
	The test mandrel is marked when unloaded so that		Р	
	any displacement can be easily detected and is then			
	subjected for 1 min to the torque as shown in Table 3.			



Page 9 of 12 TLZJ18103015897

EN 62444:2013.				
Clause	Requirement – Test	Result	Verdict	
	During this test the test mandrel shall not turn by more		Р	
	than an angle of 45C.			
	The tests shall be repeated using a test mandrel		Р	
	equivalent to the maximum value of the anchorage			
	range of the cable gland as declared by the			
	manufacturer or supplier with the test value of the			
	relevant maximum cable diameter specified in Table3.			
9.4	Resistance to impact		Р	
	Cable glands shall be resistant to impact.		Р	
	The weight shall be fitted with an impact head of		Р	
	hardened steel in the form of a hemisphere of 25 mm			
	diameter.			
	The point of impact shall be the place considered to		Р	
	be the weakest.			
	The base shall have a mass of at least 20kg or be		Р	
	rigidly fixed or inserted in the floor.			
	The sample is subjected to the weight as given in	d to the weight as given in Category 4		
	Table 4 according to the category declared by the			
	manufacturer to supplier.			
	After the test the sample shall show no signs of		Р	
	damage likely to impair safety.			
	The sample shall then be subjected to the appropriate		Р	
	tests in accordance with 12.1 but considering the			
	classification according to 6.4.1 if so declared by the			
	manufacturer or supplier.			
9.5	Excess tightening an seal performance		Р	
	Cable glands shall be capable of withstanding excess	See user manual	Р	
	tightening which is likely to occur during installation.			
	Compliance is checked with new samples by the		-	
	following test.			
	After the test, the samples shall show no signs of		Р	
	damage likely to impair safety.			



Page 10 of 12 TLZJ18103015897

EN 62444:2013.				
Clause	Requirement – Test	Result	Verdict	
	The sample shall then be subjected to the appropriate		Р	
	tests in accordance with 12.1, but considering the			
	classification according to 6.4.1 if so declared by the			
	manufacturer or supplier.			
9.6	Cable guard		N	
	A cable guard which is part of a cable gland shall be		N	
	constructed so that the flexible cable is adequately			
	protected against excessive flexing.			
	Compliance is checked in accordance with the tests		N	
	described in the relevant standard for equipment for			
	which the cable glands with guards are intended.			
10	ELECTRICAL PROPERTIES		-	
10.1	Equipotential bonding		N	
	Cable glands declared in accordance with 6.3.1.1		N	
	shall have adequate conductivity to the enclosure			
	In no case shall the resistance exceed 0,1 ohm.		N	
10.2	Electrical connection to metallic layer(s) of cable		N	
	Cable glands declared in accordance with 6.3.1.2		N	
	shall have adequate electrical connection with the			
	metallic layer of the cable			
	the resistance shall not exceed 0,1 ohm.		N	
10.3	Insulation resistance		Р	
	Cable glands declared in accordance with 6.3.2 shall		Р	
	have adequate Insulation resistance			
	Compliance is checked by 10.3.2 after 10.3.1			
10.3.1	Compliance checked by a humidity treatment carried	93%, 25°C	Р	
	out in a humidity cabinet containing air with relative			
	humidity maintained between 91 % and 95 % in			
	condition of 20-30C			
	Specimens kept in the cabinet for 120h (5 days)		Р	
10.3.2	Insulation resistance test(500 V d.c. for 1 min):		-	



Page 11 of 12 TLZJ18103015897

	EN 62444:2013.				
Clause	Requirement – Test	Result	Verdict		
	The insulation resistance shall not be les than 5 $\ensuremath{\text{M}\Omega}$	>10MΩ	Р		
10.4	Protective connection to earth		N		
	Cable glands declared in accordance with 6.3.1.3		N		
	shall resistant to earth fault current				
10.4.1	Mechanical pre-stressing		Ν		
	The load is maintained for 5 min and at the end of the		N		
	this period the displacement shall not exceed 3mm at				
	either cable gland				
10.4.2	Electrical current test		Ν		
11	ELECTROMAGNETIC COMPATIBILITY		Ν		
12	EXTERNAL INFLUENCES				
12.1	IP code in accordance with EN60529	IP68(<0.5m)	Р		
	The degree of protection provided by cable glands is		Р		
	checked in accordance with 12.1.1 immediately				
	followed by 12.1.2				
12.1.1	IPX4 or above	IP6X	Р		
	The sample is deemed to have passed the test if		Р		
	there is no ingress of dust				
12.1.2	IP4X or above	IPX8	Р		
	The sample is deemed to have passed the test if		Р		
	there is no ingress of water visible to normal or				
	corrected vision without magnification.				
12.2.	Resistance to abnormal heat		Р		
	Exposed non-metallic parts of cable glands shall be		Р		
	resistant to abnormal heat from an external source				
	Sealing systems are exempt from this test		Р		
	Temperature of glow wire is 650C		Р		
	No visible flame or glowing	No visible flame	Р		
	Flame and glowing extinguish within 30 s		N		
	No ignition of the tissue paper		Р		
12.3	Resistance to salt and sulphur dioxide Lander		N		



Page 12 of 12 TLZJ18103015897

	EN 62444:2013.						
Clause	ause Requirement – Test Result Verdict						
	atmospheres						
	Cable glands if declared in accordance with 6.4.3		N				
	shall have adequate resistance to salt and sulphur						
	dioxide laden atmospheres						
	After each test, the samples are to be carefully rinsed		N				
	and dried and shall show no sign of corrosion						
	Discoloration and effects on sealing systems are		N				
	neglected						

TABLE: List of Components					
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity
¹⁾ An asterisk indicates a mark which assures the agreed level of surveillance					

- End of Test Report -



Annex I:

Page 1 of 3

TLZJ18103015897

Type of equipment, model: Cable Glands

Details of:



Details of:






Page 2 of 3

TLZJ18103015897

Details of:



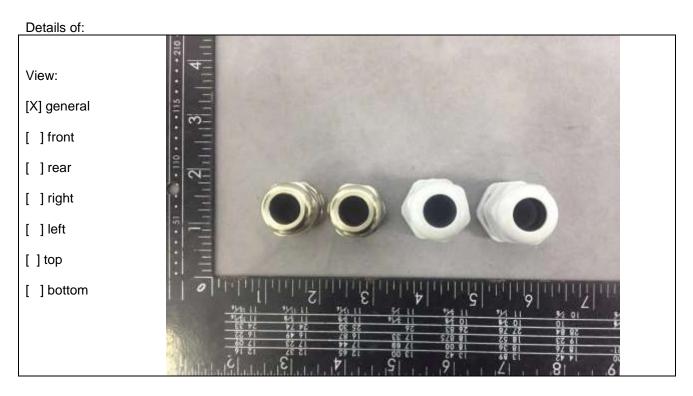



Page 3 of 3





-End of Photo Documentation -